
# FINAL SCOPING REPORT



# PART A: MAIN REPORT

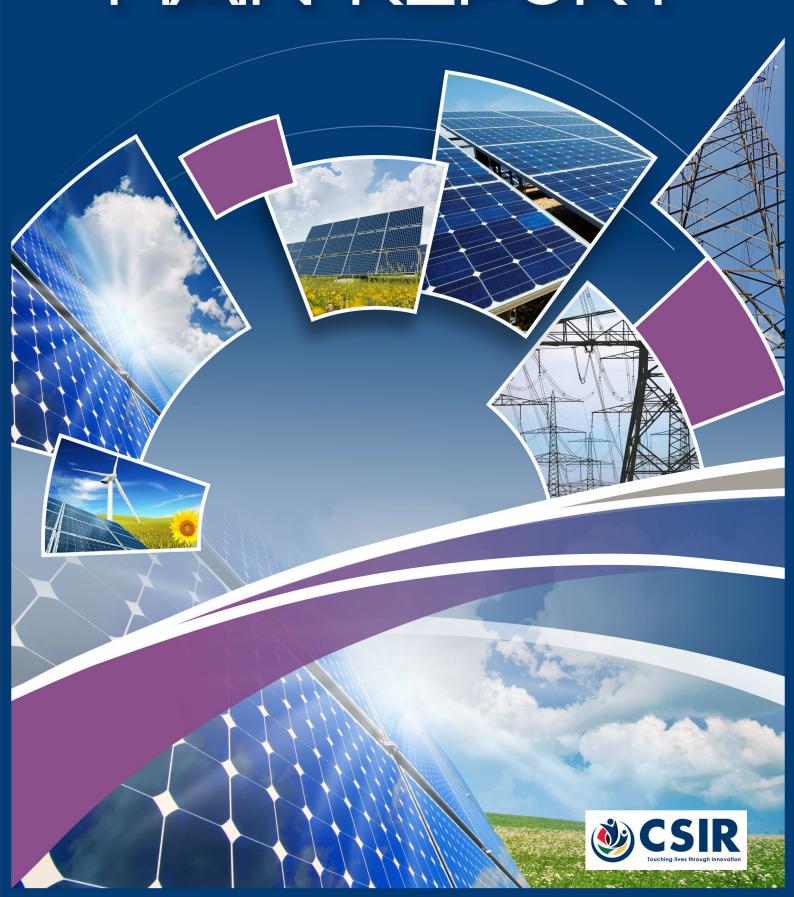

## SCOPING AND ENVIRONMENTAL IMPACT ASSESSMENT

#### for the

Proposed Development of a Solar Photovoltaic (PV) Facility and associated infrastructure (Biesjesvlei PV3); Battery Energy Storage System and associated infrastructure (Biesjesvlei BESS 3); and 132 kV Overhead Power Line from the on-site substation to a proposed Main Transmission Substation and associated infrastructure (Biesjesvlei EGI 3); near Smithfield, within the Mohokare Local Municipality, Xhariep District Municipality, Free State

## FINAL SCOPING REPORT

## April 2024

### Prepared for:

Scatec Africa (Pty) Ltd and Veroniva (Pty) Ltd

## Prepared by:

Council for Scientific and Industrial Research (CSIR)

P. O. Box 320, Stellenbosch, 7599 Tel: 021 888 2400 Postnet Suite 367, Private Bag x10, Musgrave Road, 4062; Tel: 031 242 2300

## Lead Authors:

Paul Lochner, Rohaida Abed, Suvasha Ramcharan, and Helen Antonopoulos (CSIR)

## Specialists:

Johann Lanz; Corné Niemandt; Russell Tate; Samuel Laurence; Quinton Lawson; Bernard Oberholzer; Dr Jayson Orton; Dr John Almond; Sue Reuther; Annebet Krige; Dale Barrow; Hardy Luttig; Louis Jonk; Julian Conrad; and Debbie Mitchell

#### Mapping:

Luanita Snyman-Van der Walt (CSIR)

## Formatting and Desktop Publishing:

Magdel van der Merwe (DTP Solutions)

© CSIR 2024. All rights to the intellectual property and/or contents of this document remain vested in the CSIR. This document is issued for the sole purpose for which it is supplied. No part of this publication may be reproduced, stored in a retrieval system or transmitted, in any form or by means electronic, mechanical, photocopying, recording or otherwise without the express written permission of the CSIR. It may also not be lent, resold, hired out or otherwise disposed of by way of trade in any form of binding or cover than that in which it is published.

## Report Details

## Title: Scopi

Scoping and Environmental Impact Assessment for the Proposed Development of a Solar Photovoltaic (PV) Facility and associated infrastructure (Biesjesvlei PV3); Battery Energy Storage System and associated infrastructure (Biesjesvlei BESS 3); and 132 kV Overhead Power Line from the on-site substation to a proposed Main Transmission Substation and associated infrastructure (Biesjesvlei EGI 3); near Smithfield, within the Mohokare Local Municipality, Xhariep District Municipality, Free State: FINAL SCOPING REPORT.

## Purpose of this report:

The purpose of this Final Scoping Report is to:

- Present the details of and the need for the proposed projects;
- Describe the affected environment at a sufficient level of detail to facilitate informed decisionmaking;
- Provide an overview of the Scoping Process that has been followed, including public consultation;
- Provide an overview of the potential positive and negative impacts of the proposed projects on the environment:
- Provide recommendations to avoid or mitigate negative impacts and to enhance the positive benefits of the proposed projects (based on a high-level); and
- Provide the Plan of Study for the EIA Phase for the proposed projects.

The Draft Scoping Report was made available to all Interested and/or Affected Parties (I&APs), Organs of State and relevant stakeholders for a 30-day review period, which extended from 8 March 2024 to 10 April 2024, excluding public holidays. All comments submitted during the 30-day review period have been incorporated in a Comments and Responses Report, and addressed, as applicable and where relevant, and is included as an appendix to this Final Scoping Report. The Final Scoping Report is being submitted to the National Department of Forestry, Fisheries and the Environment (DFFE) for consideration.

## Prepared for: Prepared by:

Scatec Africa (Pty) Ltd and Veroniva (Pty) Ltd

CSIR:

P. O. Box 320, Stellenbosch, 7599 Postnet Suite 367, Private Bag x10, Musgrave Road,

4062

Tel: 021 888 2400 Tel: 031 242 2300 Email: ems@csir.co.za Email: ems@csir.co.za

Lead Authors: Mapping: Specialists: Paul Lochner, Rohaida Abed, Suvasha Ramcharan and Helen Antonopoulos (CSIR)

Luanita Snyman-Van der Walt (CSIR)

Johann Lanz; Corné Niemandt; Russell Tate; Samuel Laurence; Quinton Lawson; Bernard Oberholzer; Dr Jayson Orton; Dr John Almond; Sue Reuther; Annebet Krige; Dale Barrow; Hardy Luttig; Louis Jonk; Julian Conrad; and Debbie Mitchell

Formatting and Desktop Publishing:

Magdel van der Merwe, DTP Solutions

Date:

**DFFE Reference No:** 

### April 2024

- Biesjesvlei PV3: 14/12/16/3/3/2/2533
- Biesjesvlei BESS 3: 14/12/16/3/3/2/2532
- Biesjesvlei EGI 3: 14/12/16/3/3/2/2534

To be cited as:

# Contents

PART A:	MAIN REPORT					
Executive Summary						
Chapter 1	Introduction					
Chapter 2	Project Description					
Chapter 3	Description of the Affected Environment					
Chapter 4	Approach to EIA Process and Public Participation					
Chapter 5	Project Alternatives					
Chapter 6	Issues and Potential Impacts					
Chapter 7	Plan of Study for EIA					
PART B:	APPENDICES					
Appendix A	Curriculum Vitae of the Environmental Assessment Practitioners					
Appendix B	Declaration of Independence of the Environmental Assessment Practitioner					
Appendix C	Pre-Consultation with the Competent Authority					
Appendix D	Maps					
Appendix E	Specialist Site Sensitivity Verifications and Inputs					
Appendix F	Database of Interested and/or Affected Parties					
Appendix G	Public Participation for the Scoping Phase					
Appendix H	Additional Information					

# Key Changes made from the DRAFT Scoping Report that was issued for I&AP, Stakeholder and Organ of State Review from 8 March 2024 to 10 April 2024

					Change	made -	· Yes (de	noted by	/ <b>✓</b> ) or I	N/A (den	oted by	)				
	Chapters									Appendices						
Key change description	Summary	1	2	3	4	5	6	7	Α	В	С	D	E	F	G	Н
The term "Draft Scoping Report" and has been updated to "Final Scoping Report", where applicable	✓	✓	✓	✓	✓	✓	✓	✓							✓	
Status update provided on Bid Window 7 of the Renewable Energy Independent Power Producer Programme (REIPPPP)		✓				✓										
Link to Appendix G.6 of the Final Scoping Report which includes feedback from the South African Heritage Resources Agency (SAHRA) on the acceptance of the approach followed for Palaeontology (i.e. Site Sensitivity Verification confirming low to very low sensitivity with no further Palaeontology assessment needed).	<b>~</b>	✓			<b>✓</b>		<b>✓</b>	<b>✓</b>							<b>\</b>	
Section 4.1.1.6 of Chapter 4 of the Final Scoping Report has been added to include feedback on the DFFE Solar Exclusion Norm published in GG 50388, GN 4558 on 27 March 2024.					✓											
Provision for the capacity of the Battery Energy Storage System (BESS) in the project description	✓		✓													
Feedback that vegetation under the panels will be trimmed using manual mechanisms, not chemical treatment			✓													
Update of the preliminary mitigation measure for potential avifaunal impacts as follows (i.e. specifying that power lines of 132 kV or lower voltages should be considered to be placed underground where possible): Where possible, power lines of 132 kV or less should be buried underground.							<b>✓</b>									
Inclusion of Table 7.7 that provides a summary of the key issues raised by stakeholders during the 30-day review period on the Draft Scoping Report, as well as summarised key responses. Feedback that the issues raised by stakeholders during the 30-day review period on the Draft Scoping Report are in line with the potential impacts and issues initially raised by the specialists for further assessment in the EIA Phase. Feedback that no changes needed to be made to the Plan of Study for EIA based on comments received.								<b>✓</b>								
Updated with SAHRA Case Numbers assigned to the projects.					✓										<b>√</b>	

					Change	made -	· Yes (de	noted by	/ <b>√</b> ) or I	N/A (der	oted by	)				
				Chapte	rs							Appe	ndices			
Key change description	Summary	1	2	3	4	5	6	7	Α	В	С	D	Е	F	G	Н
Updated with Department of Forestry, Fisheries and the Environment (DFFE) Reference Numbers assigned to the projects.	<b>~</b>				<b>√</b>			✓							<b>✓</b>	<b>✓</b>
Updated with details of the Public Participation Process undertaken thus far, including the status and progress made on the Scoping Process such as status of comments received from key organs of state.	>	<b>&gt;</b>	<b>✓</b>		✓	✓	1	✓							>	
Updated with additional information regarding the submission of the Application for EA to the DFFE, as well as DFFE's acknowledgment of receipt.					✓										<b>&gt;</b>	
Added proof of placement of the newspaper advertisements (Appendix G.2), correspondence and proof of correspondence sent to stakeholders for the Draft Scoping Report release (Appendix G.4); proof of submission of the Draft Scoping Report and Application Form to the DFFE (Appendix G.5); comments received from stakeholders during the 30-day review of the Draft Scoping Report (Appendix G.6); and Comments and Responses Trail (Appendix G.7).															<b>√</b>	
Updated the database of I&APs, Stakeholders and Organs of State to reflect additions to and removals from the database based on requests and additional research on valid contact details.														✓		

Note from the CSIR: If sections are not mentioned in the above table, this means that either there have been no changes or no major changes to these sections.

# Executive Summary

## INTRODUCTION AND PROJECT LOCALITY

Scatec Africa (Pty) Ltd (the project owner) with support from Veroniva (Pty) Ltd, are proposing to develop three Solar Photovoltaic (PV) and Battery Energy Storage System (BESS) Facilities, and associated Electricity Grid Infrastructure (EGI), near Smithfield within the Mohokare Local Municipality, Xhariep District Municipality, Free State (Figure A). The project is referred to as the "Biesjesvlei" Solar PV, BESS and EGI development.

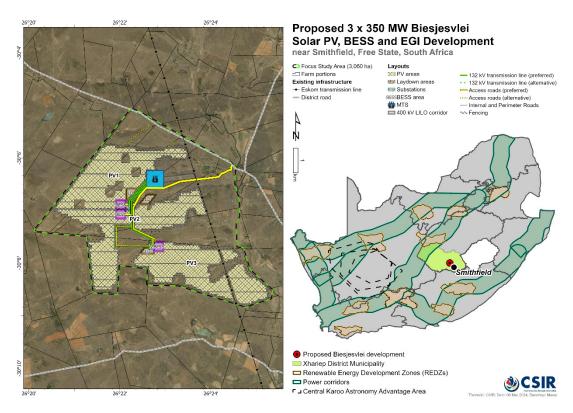


Figure A. Locality map for the proposed Biesjesvlei Solar PV1 to PV3; Biesjesvlei BESS 1
to 3; Biesjesvlei EGI 1 to 3; and Biesjesvlei MTS and LILO, near Smithfield in the
Free State.

The proposed projects are not located within any of the Renewable Energy Development Zones (REDZs) that were gazetted in GN 114 on 16 February 2018; and GN 144 on 26 February 2021. The proposed projects are also not located within any of the Strategic Transmission Corridors that were gazetted in GN 113 on 16 February 2018; and GN 1637 on 24 December 2021.

The proposed projects will make use of PV solar technology to generate electricity from energy derived from the sun. Each solar PV facility will have a range of associated infrastructure and is proposed to connect to an existing 400 kV power line via dedicated 132 kV power lines, a proposed independent Main Transmission Substation (MTS) and a Loop-In-Loop-Out (LILO).

Each of the Solar PV Facilities would be its own project and would require its own, separate Environmental Authorisation (EA). The same applies to the BESS and EGI projects. Each project will have a specific Project Applicant. The following projects are being proposed (Figure B):

- PROJECTS 1 TO 3: The proposed development of three Solar PV Facilities and associated infrastructure (i.e. Biesjesvlei PV1 to Biesjesvlei PV3).
- PROJECTS 4 TO 6: The proposed development of three BESS and associated infrastructure (i.e. Biesjesvlei BESS 1 to Biesjesvlei BESS 3).
- PROJECTS 7 to 9: The proposed development of a 132 kV Overhead Power Line from each Biesjesvlei PV Facility to the proposed MTS, and associated infrastructure (i.e. Biesjesvlei EGI 1 to Biesjesvlei EGI 3).
- PROJECT 10: The proposed development of an independent 400/132kV MTS and a 400 kV LILO from the MTS to the existing Eskom power line, as well as associated infrastructure (i.e. Biesjesvlei MTS and LILO).

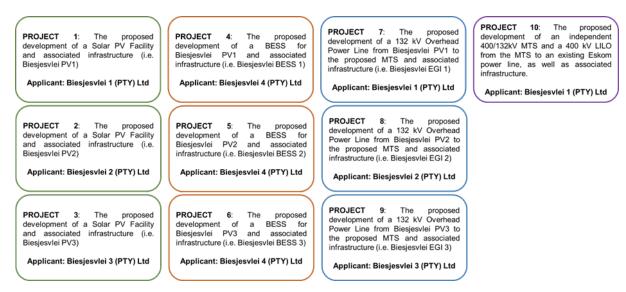


Figure B: Breakdown of the projects that comprise the Biesjesvlei Solar PV, BESS, EGI,

MTS and LILO Development.

## REPORT COMBINATION AND AVAILABILITY

A request to combine the Environmental Assessment reporting, for Projects 1 to 9, in terms of Regulation 11 of the 2014 National Environmental Management Act (Act 107 of 1998, as amended) (NEMA) Environmental Impact Assessment (EIA) Regulations (as amended), and the issuing of multiple EAs in terms of Regulations 25 (1) and (2) was discussed with the National Department of Forestry, Fisheries and the Environment (DFFE) at the Pre-Application Meeting on 6 October 2023. A letter was submitted to the DFFE to request for the combination and issuing of multiple EAs in October 2023. The DFFE approved the request for combination and multiple EAs (should they be granted) in a letter dated 1 November 2023, sent via email on 6 November 2023.

The report for Project 10 (Biesjesvlei MTS and LILO) is not included in the combined reporting because only one EA is required for this project. Hence, one standalone report has been compiled for Project 10.

The reporting structure indicated in Figure C is being used.

In summary, separate combined reports have been compiled for each PV Facility, BESS and EGI cluster (i.e. Projects 1 to 9) and a separate Scoping Report has been compiled for the MTS and LILO (i.e. Project 10). Overall, four Scoping Reports have been compiled for the proposed development, and it is proposed that 10 separate EAs will be issued (should they be granted).

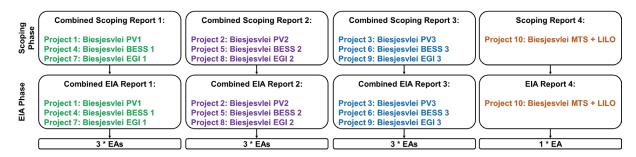


Figure C: Environmental Assessment Reporting Structure for the Biesjesvlei Solar PV, BESS, EGI, MTS and LILO Development.

This combined Scoping Report only addresses Biesjesvlei PV3, Biesjesvlei BESS 3 and Biesjesvlei EGI 3 (i.e. Projects 3, 6 and 9, respectively).

Note: The information throughout this Executive Summary applies to each of the projects addressed in this report (i.e. Project 3 (Biesjesvlei PV3), Project 6 (Biesjesvlei BESS 3) and Project 9 (Biesjesvlei EGI 3)), unless where mentioned otherwise.

The Draft Scoping Report was released to all Interested and/or Affected Parties (I&APs), Organs of State and relevant stakeholders for a 30-day review period, which extended from 8 March 2024 to 10 April 2024 (excluding public holidays). All comments received during the 30-day review have been incorporated into a detailed Comments and Responses Report, and addressed, as applicable and where relevant, and have been included as Appendix G.7 of this Final Scoping Report. The Final Scoping Report is being submitted to the DFFE for consideration.

An integrated Public Participation Process is being undertaken for the proposed projects (i.e. Projects 1 to 10).

## COMPETENT AUTHORITY AND APPLICANTS

The Competent Authority for the proposed projects is the DFFE, and the Project Applicants are as follows:

- Project 3: Biesjesvlei PV3 and associated infrastructure: Biesjesvlei 3 (Pty) Ltd;
- Project 6: Biesjesvlei BESS 3 and associated infrastructure: Biesjesvlei 4 (Pty) Ltd; and
- Project 9: Biesjesvlei EGI 3 and associated infrastructure: Biesjesvlei 3 (Pty) Ltd.

## **NEED FOR THE EIA**

The proposed projects trigger the need for an EA in terms of the 2014 NEMA EIA Regulations (as amended) published in GN R326, R327, R325 and R324 and further amended on 11 June 2021 in GN 517; and on 3 March 2022 in GN 1816. Chapter 4 of the Scoping Report contains a detailed list of activities, which may be triggered by each project and the various project components and thus forms part of this Scoping and EIA Process. Listed below are the key listed activities triggered per project (Table A).

Table A. Key Listed Activities Per Project

Project	Listing Notice, Listed Activity and Description
Project 3: Biesjesvlei PV3 and	GN R325 (Listing Notice 2), Activity 1: The development of
associated infrastructure	facilities or infrastructure for the generation of electricity from a
	renewable resource where the electricity output is 20 megawatts
	or more, excluding where such development of facility or
	infrastructure is for photovoltaic installations and occurs (a)
	within an urban area; or (b) on existing infrastructure
Project 6: Biesjesvlei BESS 3	GN R327 (Listing Notice 1), Activity 27: The clearance of an
and associated infrastructure	area of 1 hectares or more, but less than 20 hectares of
	indigenous vegetation, except where such clearance of
	indigenous vegetation is required for (i) the undertaking of a
	linear activity; or (ii) maintenance purposes undertaken in
	accordance with a maintenance management plan.
Project 9: Biesjesvlei EGI 3	GN R327 (Listing Notice 1), Activity 11 (i): The development
and associated infrastructure	of facilities or infrastructure for the transmission and distribution
	of electricity (i) outside urban areas or industrial complexes with
	a capacity of more than 33 but less than 275 kilovolts

The purpose of the Scoping and EIA Process is to identify, assess and report on any potential impacts the proposed projects, if implemented, may have on the receiving environment. The Scoping and EIA therefore needs to show the Competent Authority and the Project Applicant what the consequences of their choices will be in terms of impacts on the biophysical and socioeconomic environment and how such impacts can be, as far as possible, enhanced or mitigated and managed as the case may be.

## PROJECT EIA TEAM

In accordance with Regulation 12 (1) of the 2014 NEMA EIA Regulations (as amended), the Council for Scientific and Industrial Research (CSIR) has been appointed by the Project Developer to undertake the required Scoping and EIA Process in order to determine the potential biophysical, social and economic impacts associated with undertaking the proposed development. The project team and the relevant specialists are indicated in Table B below. The term "N/A" in the table below indicates that the specialist study in question is not relevant to that specific project.

## Table B. Project Team for the Scoping and EIA Process

NAME	ORGANISATION	ROLE/STUDY TO BE UNDERTAKEN	PROJECT 3 – PV3	PROJECT 6 – BESS 3	PROJECT 9 – EGI 3
Environmental Management Service	es (CSIR)				
Paul Lochner (Registered EAP (2019/745))	CSIR	EAP, Technical Advisor and Quality Assurance	~	~	~
Rohaida Abed ( <i>Pr.Sci.Nat.;</i> Registered EAP (2021/4067))	CSIR	EAP and Project Manager	~	~	~
Helen Antonopoulos	CSIR	Project Officer	~	~	~
Suvasha Ramcharan (Cand.Sci.Nat.)	CSIR	Project Officer	~	~	~
Phindile Mthembu	CSIR	Project Officer	~	~	~
Luanita Snyman van der Walt ( <i>Pr.Sci.Nat.</i> )	CSIR	GIS Specialist	~	~	~
Lizande Kellerman (Pr.Sci.Nat.)	CSIR	Public Participation Specialist	~	~	~
Specialists					
Johann Lanz ( <i>Pr.Sci.Nat.</i> )	Private	Agriculture and Soils Compliance Statement	~	~	~
Corné Niemandt ( <i>Pr.Sci.Nat.</i> ) Samuel Laurence ( <i>Pr.Sci.Nat.</i> )	Enviro-Insight cc	Terrestrial Biodiversity Assessment, Terrestrial Plant Species Compliance Statement, and Terrestrial Animal Species Compliance Statement	~	~	~
Russell Tate (Pr.Sci.Nat.)	Tate Environmental Specialist Services (subcontracted by Envirolnsight)	Aquatic Biodiversity and Species Assessment	~	~	~
Samuel Laurence (Pr.Sci.Nat.)	Enviro-Insight cc	Avifauna Impact Assessment	~	~	~
Quinton Lawson (SACAP, 3686) Bernard Oberholzer (SACLAP, 87018)	QARC and BOLA	Visual Impact Assessment	~	~	~
Dr Jayson Orton (APHP: Member 43; ASAPA CRM Section: Member 233)	ASHA Consulting (Pty) Ltd	Heritage Impact Assessment (Archaeology and Cultural Landscape)	~	~	~
Dr John Almond (PSSA and APHP Member)	Natura Viva cc	Palaeontology	~	~	~
Sue Reuther	SLR Consulting	Socio-Economic Impact Assessment	~	~	N/A
Annebet Krige (Pr Eng)	Sturgeon Consulting	Traffic Impact Assessment	~	~	N/A
Dale Barrow ( <i>Pr.Sci.Nat.</i> ) Hardy Luttig Louis Jonk ( <i>Pr.Sci.Nat.</i> ) Julian Conrad	GEOSS South Africa (PTY) Ltd	Geohydrology Assessment	~	~	N/A
Dale Barrow ( <i>Pr.Sci.Nat.</i> ) Hardy Luttig Louis Jonk ( <i>Pr.Sci.Nat.</i> ) Julian Conrad	GEOSS South Africa (PTY) Ltd	Geotechnical Letter of Professional Opinion	~	~	~
Debbie Mitchell (Pr Eng)	Ishecon cc	Battery Storage High Level Safety, Health and Environment Risk Assessment	N/A	~	N/A
Rohaida Abed ( <i>Pr.Sci.Nat.</i> ; <i>Registered EAP</i> (2021/4067)) Lizande Kellerman ( <i>Pr.Sci.Nat.</i> ) Willan Adonis <sup>1</sup>	CSIR	Civil Aviation Site Sensitivity Verification	~	~	~
Rohaida Abed ( <i>Pr.Sci.Nat.</i> ; <i>Registered EAP</i> (2021/4067)) Lizande Kellerman ( <i>Pr.Sci.Nat.</i> ) Willan Adonis <sup>2</sup>	CSIR	Defence Site Sensitivity Verification	~	N/A	N/A

<sup>&</sup>lt;sup>1</sup> This staff member resigned from the CSIR at the end of December 2023.

<sup>&</sup>lt;sup>2</sup> This staff member resigned from the CSIR at the end of December 2023.

The specialist assessments will be detailed during the EIA Phase and will comply with Appendix 6 of the 2014 NEMA EIA Regulations (as amended), or the Assessment Protocols published in GN 320 on March 2020; or the Assessment Protocols published in GN 1150 on October 2020. However, the BESS High Level Safety, Health and Environment Risk Assessment serves as a technical report and the aforementioned legislation will thus not be applicable.

## **STUDY AREA**

The study area or preferred site for all the proposed Biesjesvlei Solar PV Facilities, BESS, 132 kV power lines, MTS and LILO and associated infrastructure (i.e., Projects 1 to 10) covers approximately 3 060 hectares (ha). These farm properties are listed in Table C, and they apply to all the projects addressed in this Scoping Report.

Table C: Farm portions and SG codes for the Study Area

FARM PORTION	SG CODE
Farm Benoni 534	F0310000000053400000
Remaining Extent of Farm Biesjespoort 521	F0310000000052100000
Farm Biesjesvlei 372	F0310000000037200000
Farm Klein Badfontein 369	F0310000000036900000
Farm Modderkuil 396	F0310000000039600000
Farm Paalland 373	F0310000000037300000
Remaining Extent of Farm Pompoenfontein 118	F0310000000011800000
Portion 1 of Farm Pompoenfontein 118	F0310000000011800001
Farm Ronde Bult 408	F03100000000040800000
Farm Salpetervlei 756	F0310000000075600000
Portion 1 of Farm Schoemanskraal 34	F0310000000003400001

As part of the Scoping and EIA Process, the full extent of the study area has been assessed by the specialists in order to identify environmental sensitivities and no-go areas. The preferred site serves as the study area for this Scoping and EIA Process. Therefore, the terms "site" and "study area" are used synonymously in the Scoping Report.

## **PROJECT DESCRIPTION**

A summary of the key components of the proposed Biesjesvlei PV3 (Project 3) and technical information is described in Table D below.

Table D. Summary of the components and associated infrastructure for Biesjesvlei PV3 (Project 3)

Component	Description						
Solar Field							
Type of Technology	Solar Photovoltaic (PV) Technology						
Generation Capacity (Maximum Installed)	■ Up to 350 MWdc						
Total footprint that includes all associated	Maximum 600 ha						
infrastructure within the fenced off area of							
the PV facility (excluding access roads)							
PV Panel Structure (with the following							
possible tracking and mounting systems):							
<ul> <li>Single Axis Tracking structures (aligned</li> </ul>							
north-south);							
<ul> <li>Fixed Axis Tracking (aligned east-west);</li> </ul>	<ul> <li>Height: Approximately 10 m (maximum)</li> </ul>						
<ul> <li>Dual Axis Tracking (aligned east-west</li> </ul>							
and north-south);							
<ul> <li>Fixed Tilt Mounting Structure; or</li> </ul>							
Bifacial Solar Modules.							
Building Infrastructure							
Offices	Maximum height: 7 m						
	■ <u>Footprint</u> : 1000 m <sup>2</sup>						
Operational and maintenance (O&M) control	■ <u>Maximum height</u> : 7 m						
centre							
	■ <u>Footprint</u> : 500 m <sup>2</sup>						
Warehouse / workshop	<ul><li>Maximum height: 7 m</li></ul>						
	■ <u>Footprint</u> : 500 m <sup>2</sup>						
Ablution facilities	<ul><li>Maximum height: 7 m</li></ul>						
	■ <u>Footprint</u> : 50 m <sup>2</sup>						
Converter / Inverter stations	■ <u>Height</u> : 2.5 m to 7 m (maximum)						
	Footprint: 2500 m <sup>2</sup>						
Guard Houses	■ <u>Height</u> : 3 m						
	Footprint: 40 m <sup>2</sup>						
On-site substation and/or switching station.	Footprint of the IPP Substation: Approximately						
This will include the section that will be	10 000 m <sup>2</sup>						
maintained by the Independent Power							
Producer (IPP).	Height: 10 m						

Component	De	escription
		Capacity: 132 kV
	-	
	•	This section includes all the high voltage
		infrastructure leading up to the Point of
		Connection (i.e. the Project Applicant's section of
		the proposed on-site substation, which is also
		referred to the PV Facility IPP Substation).
Associated Infrastructure		
On-site medium voltage internal cables / power lines	•	Placement: Underground or above ground
	•	Capacity: 33 kV
	•	Depth (if underground): Maximum depth of 1.6 m
	•	Height (if aboveground): Maximum height of 9 m
Underground low voltage cables or cable trays	•	Depth: Maximum depth of 1.4 m
External Access Roads		The study area can be accessed via various existing main roads and gravel roads. Specifically, three access route options are being considered: Access Route Option A, Option B and Option C, which are routed along the N6; S1262; and S119. Options A, B and C have different access points off the S119. Direct access to the proposed projects will be taken from the S119 along an existing farm access point, and thereafter new access roads will be developed within the study area, where they do not align with existing roads, or existing roads will be used where possible. Existing roads will be used as far as practically achievable.  New Access Roads: Where new access roads are
		required within the study area, these will be 4 - 8 m wide.
	•	Existing Access Roads: Where existing roads are used within the study area, they may need to be upgraded, as described below.
	•	<ul> <li>The Traffic Specialist has noted the following based on preliminary investigations:</li> <li>The N6, S1262, and S119 are suitable and do not need to be upgraded.</li> <li>The N6, S1262, and S119 are of a sufficient width to accommodate truck movement, however widening by more than 4 m or more than 6 m may be</li> </ul>

Component	Description
Component	required at localised positions (i.e. intersections). Specifically, road widening by approximately 9 m will be required at the S1262 and S119 intersection.  Existing internal farm roads (local farm roads within the farm property boundaries) will need to be upgraded to accommodate the abnormal loads as required. This includes the following:  Intersection S119 and Access Route Option A: Road widening by approximately 14 m (at the widest point) will be required.  Intersection S119 and Access Route Option B: Road widening by approximately 7 m (at the widest point) will be required.  Intersection S119 and Access Route Option C: Road widening by approximately 14 m (at the widest point) will be required.  An existing bridge on the S119 will also need to be inspected by a Structural Engineer.  The existing bridge on the existing internal farm road leading from Access Route Option A will most likely need to be rebuilt or realigned to minimise the turns that the abnormal loads need to navigate. Additional
	detail will be provided in the EIA Phase.
Internal roads	Details: New internal gravel roads will need to be established within the fenced off area of the PV facility.      Width: Up to 4 m.
Fencing around the PV Facility Perimeter	<ul> <li>Width: Up to 4 m</li> <li>Type: Palisade or mesh or fully electrified</li> </ul>
	Security: Access points will be managed and monitored by an appointed security service provider.
	■ <u>Height</u> : Between 2 - 3 m

Component	Des	scription
Panel maintenance and cleaning area	•	A dedicated panel maintenance and cleaning area
		will be required on site during the operational phase.
	•	Details will be confirmed during the EIA Phase.
Storm water channels	•	Details to be confirmed once the Engineering,
		Procurement and Construction (EPC) contractor has been selected and the design is finalised.
		Where necessary, a detailed storm water
		management plan would need to be developed.
Work area during the construction phase		Footprint: Up to 13 ha.
(i.e. laydown area)		· · ·
Water Requirements	•	Approximately 8 520 m <sup>3</sup> to 12 000 m <sup>3</sup> of water is estimated to be required per year for the
		construction phase.
		•
	•	Approximately 10 000 m³ to 16 000 m³ of water is
		estimated to be required per year for the
		operational phase.
		Water requirements during the decommissioning
		phase are expected to be the same as the
		construction phase.
		Potential sources: Existing boreholes on site or
		from the Local Municipality via trucks.
Construction Period	•	12 – 24 months
Operational Period	•	Once the commercial operation date is achieved,
		the proposed facility will generate electricity for a
		minimum period of 20 to 30 years.

A summary of the key components of the proposed Biesjesvlei BESS 3 (Project 6) and technical information is described in Table E below.

Table E. Summary of the components and associated infrastructure for Biesjesvlei BESS 3 (Project 6)

Component	Description				
Battery Energy Storage System (BESS)					
BESS Area/Facility	•	Technology: Lithium-Ion BESS			
	•	Estimated Capacity: Maximum 1 200 MWh			
	•	Total Footprint: Approximately 10 ha			
	•	Height: Between 5 m and 10 m			

Component	Description
- Component	The BESS area will include the following sub-
	components:
	components.
	o BESS Units;
	BESS Laydown Area;  BESS IND Substition:
	BESS IPP Substation;  Loudewin area for the BESS IPP Substation:
	Laydown area for the BESS IPP Substation;  DESC On particular and Maintain area (OSM).
	BESS Operational and Maintenance (O&M)
	Office, including Ablutions;
	o Access Roads;
	o Internal Roads;
	MV cables between BESS Units;
	o Transformer at the BESS IPP Substation;
	o Internal cables; and
	o Overhead cables at the BESS IPP
	Substation;
	<ul> <li>Fencing and Security; and</li> </ul>
	o Parking Area.
•	in the 10 ha area of the overall BESS Facility)
BESS Units	This will include battery packs or containers, with
	an area of approximately 6 ha, and height up to 5
	m.
BESS Laydown Area	<ul> <li>Footprint: Approximately 1.25 ha</li> </ul>
BESS IPP Substation	<ul><li><u>Footprint</u>: Approximately 1 ha</li></ul>
	■ <u>Height</u> : Up to 15 m
	<ul><li>Capacity: 33 kV to 132 kV</li></ul>
	This will be maintained by the IPP.
Laydown Area for the BESS IPP Substation	Footprint: Approximately 0.5 ha
BESS Operational and Maintenance (O&M)	Maximum height: Up to 5 m
Office	
	Footprint: Approximately 0.5 ha
	The BESS O&M Office will also include Ablution
	facilities.
External Access Roads	Refer to Table D for a description on the access
	roads.
Internal Roads	Details: New internal gravel roads will need to be
	established within the BESS facility area.
	Width: Up to 4 m
Medium Voltage (MV) cables between the	Placement: Buried/Ducted
BESS Units	
	<ul> <li><u>Capacity</u>: Ranges from 1 kV up to 33 kV</li> </ul>
	■ <u>Depth</u> : Up to 2 m

0	Beautifus
Component	Description
Transformer at the BESS IPP Substation	Placement: Buried/Ducted
	<ul> <li>Capacity: Ranges above 33 kV</li> </ul>
	■ Depth/Height: Up to 2 m
Internal cables in the BESS facility	Placement: Buried / ducted
	■ <u>Capacity:</u> Ranges from 1 kV up to 33 kV
	■ Depth: Up to 2 m
Overhead cables at the BESS IPP	■ Placement: Overhead
Substation	<u>riadoment</u> . Overhead
	■ <u>Capacity</u> : Ranges above 33 kV
	■ Height: Up to 12 m
Fencing of the BESS Facility and Security	Type: Palisade or mesh or fully electrified
	■ <u>Height</u> : Up to 5 m
	<ul> <li><u>Security</u>: Access to the BESS Facility will be managed and monitored by an appointed security service provider.</li> </ul>
Parking Area	<ul> <li>A parking area will be established at the BESS Facility for staff</li> </ul>
Storm water channels	<ul> <li>Details to be confirmed once the Engineering, Procurement and Construction (EPC) contractor has been selected and the design is finalised. Where necessary, a detailed storm water management plan would need to be developed.</li> </ul>
Water Requirements	<ul> <li>Approximately 350 m³ to 450 m³ of water is estimated to be required per year for the construction phase.</li> </ul>
	<ul> <li>Approximately 200 m³ to 300 m³ of water is estimated to be required per year for the operational phase.</li> </ul>
	<ul> <li>Water requirements during the decommissioning phase are expected to be the same as the construction phase.</li> </ul>
	Potential sources: Existing boreholes on site or from the Local Municipality via trucks.
Construction Period	■ 12 - 24 months
Operational Period	<ul> <li>Once the commercial operation date is achieved, the proposed BESS will store and dispatch electricity for a minimum period of 20 to 30 years.</li> </ul>

A summary of the key components of the proposed Biesjesvlei EGI 3 (Project 9) and technical information is described in Table F below.

Table F. Summary of the components and associated infrastructure for Biesjesvlei EGI 3 (Project 9)

Component	Des	scription
On-site substation and/or switching station.	•	Footprint: Up to 10 000 m <sup>2</sup>
This will include the section that will be		, seep op 10 10 000
transferred from the Independent Power		Height: Up to 15 m
Producer (IPP) to Eskom.		ŭ i
	•	Capacity: 132 kV
	•	The section includes all the high voltage
		infrastructure extending from the Point of
		Connection (i.e. Eskom's section of the proposed
		on-site substation, which is also referred to as the
132 kV Overhead Power Line	•	Switching Station).  The power line will be routed from the on-site
132 kV Overhead Fower Line	•	substation to the proposed MTS.
		substation to the proposed WTS.
		Height: Up to 37 m
	•	Length:
		<ul> <li>Preferred Power Line Route: Up to 3 km</li> </ul>
		o Alternative Power Line Route: Up to 5 km
		0 11 10 11
	•	Servitude: 40 m wide
	•	Pylon specifications:
		<ul> <li><u>Type</u>: Lattice structures or monopoles.</li> </ul>
		o <u>Tower</u> : Self-supporting and Angle Strain.
		Equipolation: The size of the featurint area
		<ul> <li>Foundation: The size of the footprint area for the base of the tower foundation will</li> </ul>
		range from $0.36 \text{ m}^2$ to $2.25 \text{ m}^2$ . The
		minimum working area required around a
		structure position is 20 m x 20 m.
		·
		<ul> <li>Span Length: 200 m – 300 m</li> </ul>
Service Road	•	<u>Details</u> : A new gravel service road will need to be
		established below the power line.
		Width: Up to 4 m
External Access Roads	-	Refer to Table D for a description on the access
External / toocoo reads		roads.

Component	Description
Storm water channels	<ul> <li>Details to be confirmed once the Engineering, Procurement and Construction (EPC) contractor has been selected and the design is finalised. Where necessary, a detailed storm water management plan would need to be developed.</li> </ul>
Work area during the construction phase (i.e. laydown area)	■ Footprint: 0.5 ha to 1 ha
Water Requirements	<ul> <li>Approximately 100 m<sup>3</sup> of water is estimated to be required per year for the construction phase.</li> </ul>
	<ul> <li>Water requirements during the decommissioning phase are expected to be the same as the construction phase.</li> </ul>
	<ul> <li>Potential sources: Existing boreholes on site or from the Local Municipality via trucks.</li> </ul>
Construction Period	• 6 - 24 months

## POTENTIAL ISSUES AND HIGH-LEVEL IMPACT ASSESSMENT

Potential key preliminary issues and impacts associated with the proposed projects, and preliminary mitigation measures have been identified by the specialist team for the Scoping Phase. This is based on an evaluation of the status quo of the receiving environment, by the specialists, either through desktop assessments or site investigations, where relevant and required. The impact ratings and mitigation measures are high-level for the purposes of Scoping, and, where necessary, will be confirmed and detailed during the EIA Phase.

These preliminary key potential issues and direct impacts are summarised in Table G below and are included in Chapter 6 of this Scoping Report. Issues raised during the 30-day review period on the Draft Scoping Report were in line with the potential issues identified below for further assessment in the EIA Phase. The Terms of Reference for the various Specialist Assessments and Inputs are included in Chapter 7 of this Scoping Report.

At the Scoping Phase, based on the preliminary impacts described below, there are no negative impacts that are rated as Very High significance after mitigation. Overall, it can be concluded that the effect of potential impacts can be limited or reduced to acceptable levels through avoidance, minimisation and the implementation of appropriate mitigation measures and management actions during the construction, operational and decommissioning phases.

Table G. Summary of Issues to be addressed during the EIA Phase as part of the Specialist Assessments / Inputs<sup>3</sup>.

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)		
	Construction, Operational and Decommission	ning Phases				
	<ul> <li>Loss of agricultural potential by occupation of land;</li> </ul>					
	<ul> <li>Loss of agricultural potential by soil degradation;</li> </ul>					
Agriculture	Loss of agricultural potential by dust generation;	<b>√</b>	✓	./		
	<ul> <li>Increased financial security for farming operations (positive impact); and</li> </ul>	•	•	•		
	<ul> <li>Improved security against stock theft and other crime due to the presence of</li> </ul>					
	security infrastructure and security personnel (positive impact).					
	Construction Phase					
	Habitat loss and fragmentation.	✓	✓	✓		
	<ul> <li>Loss of protected species;</li> </ul>	,				
	<ul> <li>Increased alien invasive species;</li> </ul>			,		
Terrestrial	<ul> <li>Increased erosion and soil compaction; and</li> </ul>	<b>~</b>		<b>√</b>		
Biodiversity and	Littering and general pollution.					
Species (including	Operational Phase					
Animal and Plant	Increased alien invasive species.	✓	✓	✓		
Species)	Loss of species composition and diversity; and	,		,		
	Littering and general pollution.	<b>√</b>		<b>√</b>		
	Decommissioning Phase					
	Loss of habitat; and		,	,		
	Increased alien invasive species	<b>✓</b>	<b>✓</b>	<b>v</b>		
Aquatic Biodiversity	Construction, Operational and Decommissio	ning Phases				
and Species	Habitat Quality Degradation;	<b>/</b> /	✓			
and Species	Water Quality Degradation; and					

mnosto / igayoo in the table o

<sup>&</sup>lt;sup>3</sup> Impacts / issues in the table are all classified as negative, except where specified as positive.

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)		
	<ul> <li>Aquatic Habitat Connectivity Loss.</li> </ul>					
	Construction Phase					
	<ul><li>Habitat destruction;</li></ul>					
	Disturbance of bird roosts; and	✓	<b>J</b>			
	<ul> <li>Disturbance due to noise such as machinery movements and construction activities.</li> </ul>	•	•			
	<ul> <li>Disturbance of foraging and breeding behaviours of birds due to noise, dust and lighting; and</li> </ul>			,		
	Loss of habitat due to clearing, trenching, alteration and exclusion from			<b>√</b>		
	previously accessible habitats.					
	Operational Phase					
	Disturbance due to noise such as, machinery movements and maintenance					
	operations;					
Avifauna	<ul><li>Loss of Bird Foraging Habitat;</li></ul>	✓	✓			
	Attraction to the facility; and					
	Chemical pollution spills.					
	Bird mortalities; and  Bird mortalities; and	✓				
	Disruption of bird migratory pathways during the operational phase.					
	<ul> <li>Continued disturbance due to operational activities (use of vehicles, lights etc.);</li> </ul>					
	Loss of habitat due to altered and excluded habitats and threat of fire:					
	<ul> <li>Direct mortality from electrocution and collision with infrastructure (e.g.</li> </ul>			✓		
	fences, overhead power lines);					
	Attraction to the facility exacerbating potential impacts.					
	Decommissioning Phase					
	Disruption of bird migratory pathways during the decommissioning phase.	✓				

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)		
	<ul> <li>Habitat loss reclamation from rehabilitation activities (positive impact).</li> </ul>	✓		✓		
	<ul> <li>Disturbance of foraging and breeding behaviours of birds due to noise, dust and lighting.</li> </ul>		✓			
	<ul> <li>Continued disturbance due to decommissioning activities (use of vehicles, lights etc.);</li> <li>Removal of power lines to promote safe passage (lowering collision risk) through the site and avoiding attraction by birds perching and nesting (positive impact).</li> </ul>			<b>√</b>		
	Construction Phase					
	<ul> <li>Potential effect of dust and noise from trucks and construction machinery during the construction period, and the effect of this on nearby farmsteads and visitors to the area; and</li> <li>Potential visual effect of haul roads, access roads, stockpiles and construction camps in the visually exposed landscape.</li> </ul>	✓	✓	✓		
Vieuel	Operational Phase					
Visual	<ul> <li>Potential visual intrusion of the facility and all associated infrastructure on receptors; and</li> <li>Potential visual impact of an industrial type of activity on the pastoral / rural character and sense of place of the area.</li> </ul>	<b>√</b>	<b>√</b>	<b>√</b>		
	Decommissioning Phase					
	<ul> <li>Potential visual effect of any remaining structures, platforms and disused roads on the landscape.</li> </ul>	✓	✓	✓		
Heritage (including	Construction Phase					
Archaeology and Cultural Landscape)	<ul> <li>Damage or destruction of archaeological materials;</li> <li>Damage or destruction of graves;</li> <li>Damage to built heritage resources; and</li> </ul>	<b>√</b>	<b>✓</b>	<b>√</b>		

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)	
	<ul> <li>Intrusion of the facility, equipment and all associated infrastructure into the landscape.</li> </ul>				
	Operational and Decommissioning Phases				
	<ul> <li>Intrusion of the facility, equipment and all associated infrastructure into the landscape.</li> </ul>	✓	✓	✓	
	Note that a palaeontological impact assessment is not required. Refer to the Pala	0,	•	` ,	
	Appendix E.7 of this Scoping Report for additional information on the palaeontol	••	•		
Palaeontology	on the motivation for no further palaeontology assessments being required for the		• •	•	
	and supported by the South African Heritage Resources Agency (SAHRA), as indicated in Appendix G.6 of this Final Scoping				
	Report.  Construction Phase				
	Capital investment contributing to the national, regional and local economy				
	(positive impact);				
	<ul> <li>Generation of employment, income and skills (positive impact);</li> </ul>				
	<ul> <li>Social disruption and change in social dynamics; and</li> </ul>	✓	✓		
	Reduced quality of life and increased risks due to construction near				
	residences.				
	Operational Phase				
Socio-Economic	Operational investment contributing to the national, regional and local				
	economy (positive impact);				
	<ul> <li>Generation of employment, income and skills (positive impact);</li> </ul>				
	<ul> <li>Increased community prosperity through contributions and income from the</li> </ul>	✓	✓		
	proposed projects (positive impact); and				
	<ul> <li>Increased South African power generation reducing the probability of load shedding (positive impact).</li> </ul>				
	Decommissioning Phase				
	Reduced employment and Funding.	<b></b>	<b></b>		
	1 , ,,	•	•		

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)		
	Construction and Decommissioning Phases					
Traffic	<ul> <li>Congestion and delays on road network;</li> <li>Potential impact on traffic safety and increase in accidents with other vehicles and animals;</li> <li>Condition of road surface;</li> <li>Dust Pollution; and</li> <li>Noise Pollution.</li> </ul>	✓	✓			
	Operational Phase					
	The traffic generated during the operational phase will not have a significant impa	act on the surro	unding road net	work.		
	Construction Phase					
	<ul> <li>Lowering of groundwater levels as a result of over-abstraction;</li> <li>Accidental oil spillage / fuel leakage; and</li> <li>Foundation construction occurring below the water table potentially impacting on ground water quality.</li> </ul>	<b>√</b>	<b>√</b>			
	Operational Phase					
Geohydrology	Lowering of groundwater levels as a result of over-abstraction.	✓	✓			
Geonydrology	<ul> <li>Potential impact on groundwater quality as a result of using cleaning agents for solar panel cleaning.</li> </ul>	✓				
	<ul> <li>Potential impact on groundwater quality as a result of potential spillage associated with the Battery Energy Storage System (BESS).</li> </ul>		✓			
	Decommissioning Phase					
	<ul> <li>Accidental oil spillage / fuel leakage; and</li> <li>Lowering of groundwater levels as a result of over-abstraction.</li> </ul>	✓	✓			
	Construction Phase					
Geotechnical	Displacement of geologic material.	✓	✓	<b>√</b>		

Specialist Assessment / Input	Key Issues / Impacts to be addressed in the EIA Phase	Project 3 (Biesjesvlei PV3)	Project 6 (Biesjesvlei BESS 3)	Project 9 (Biesjesvlei EGI 3)
	Construction, Operational and Decommission	ning Phases		
	Contamination of subsoils and loss of topsoil.	✓	✓	✓
	Operational and Decommissioning Pl	nases		
	<ul> <li>Increased unnatural hard surfaces yielding increased runoff, potentially increasing erosion.</li> </ul>	✓	<b>√</b>	<b>√</b>
High-level Safety,	Note that a high-level SHE Risk Assessment has been commissioned for the proposed BESS project. It is a technical study, and			
Health and	formal impact assessments are not required. The study will be finalised during the EIA Phase.			
Environment (SHE)				
Risk Assessment				
for the BESS				
Civil Aviation	Note that there are no impacts with respect to Civil Aviation as confirmed throu	ugh the Site Se	nsitivity Verifica	tion included in
J.V.I. / WIGHTON	Appendix E.13 of the Scoping Report.			
Defence	Note that there are no impacts with respect to Defence as confirmed through the Site Sensitivity Verification included in Appendix			
Bololloc	E.14 of the Scoping Report.			