

FINAL BASIC ASSESSMENT REPORT

APPENDIX C



Maps



CONTENTS

C. 1: Proposed 132 kV overhead powerline routing	1
C. 2: Environmental Sensitivity Maps	3

FIGURES

Figure C.1:	Locality of the seven proposed 132 kV overhead transmission powerline projects situated south of Beaufort West in the Western Cape	1
Figure C.2:	The proposed Kwagga EGI Section 1 of the 132 kV overhead powerline corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation	2
Figure C.3:	Civil Aviation Features relative to the seven proposed 132 kV overhead transmission powerline projects site based on the	3
Figure C.4:	Defence Features relative to the seven proposed 132 kV overhead transmission powerline projects site based on the	4
Figure C.5:	Combined environmental sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation	5
Figure C.6:	Environmental features map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	6
Figure C.7:	Visual sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	7
Figure C.8:	Avifauna sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	8
Figure C.9:	Heritage sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	9
Figure C.10:	Palaeontological sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	10
Figure C.11:	Terrestrial Biodiversity and Aquatic sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.	11

C. 1: Proposed 132 kV overhead powerline routing

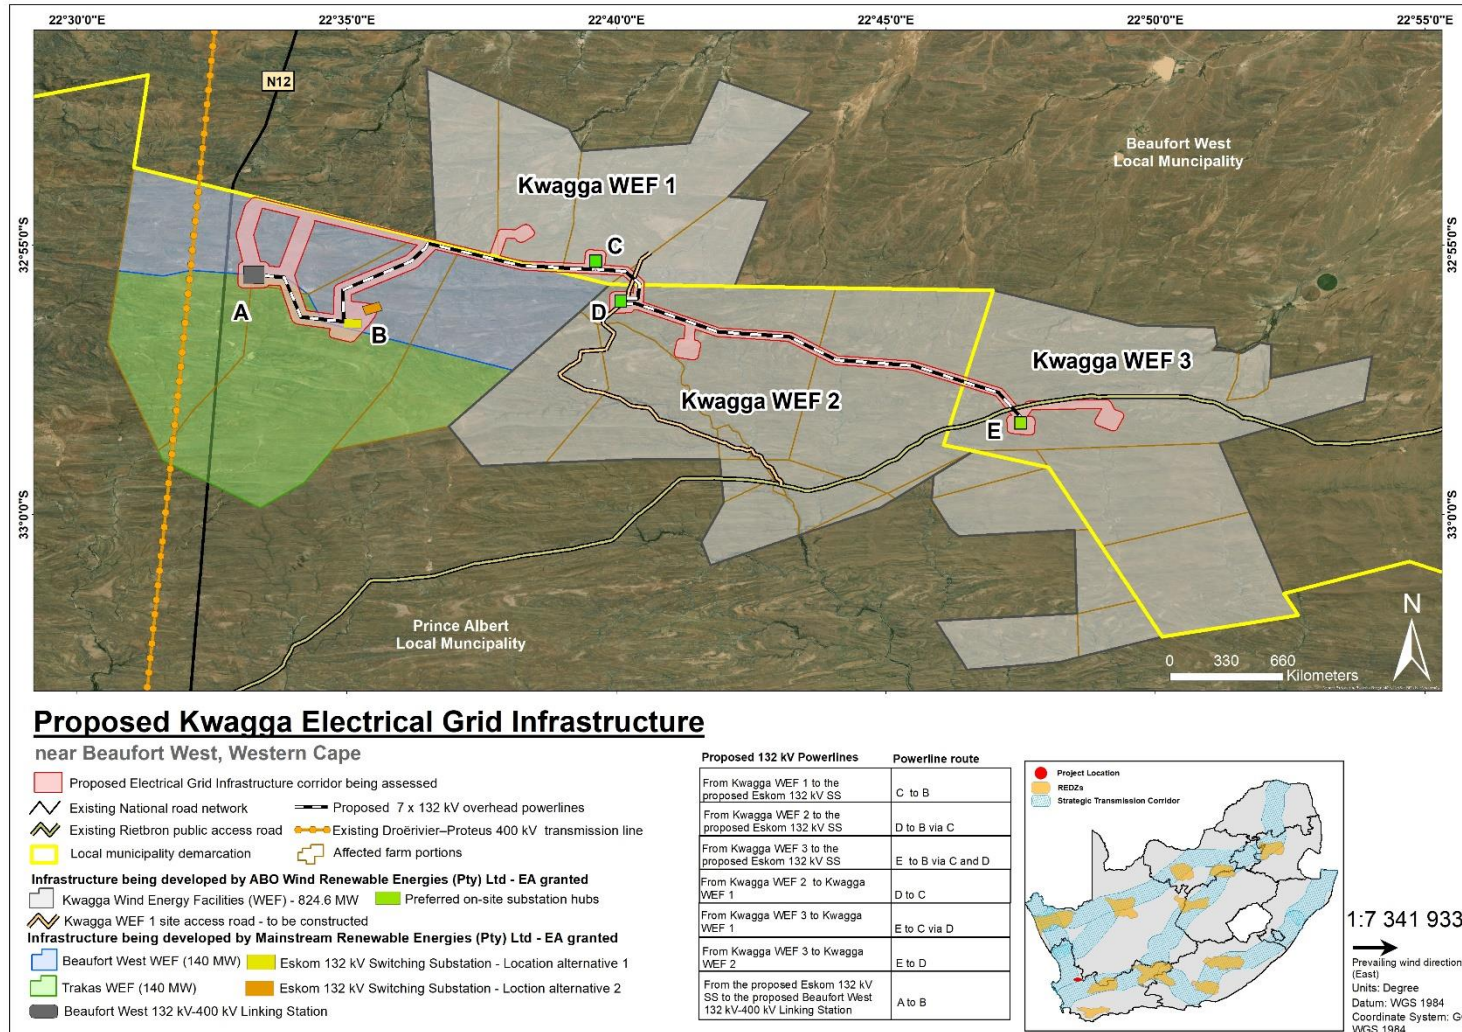


Figure C.1: Locality of the seven proposed 132 kV overhead transmission powerline projects situated south of Beaufort West in the Western Cape

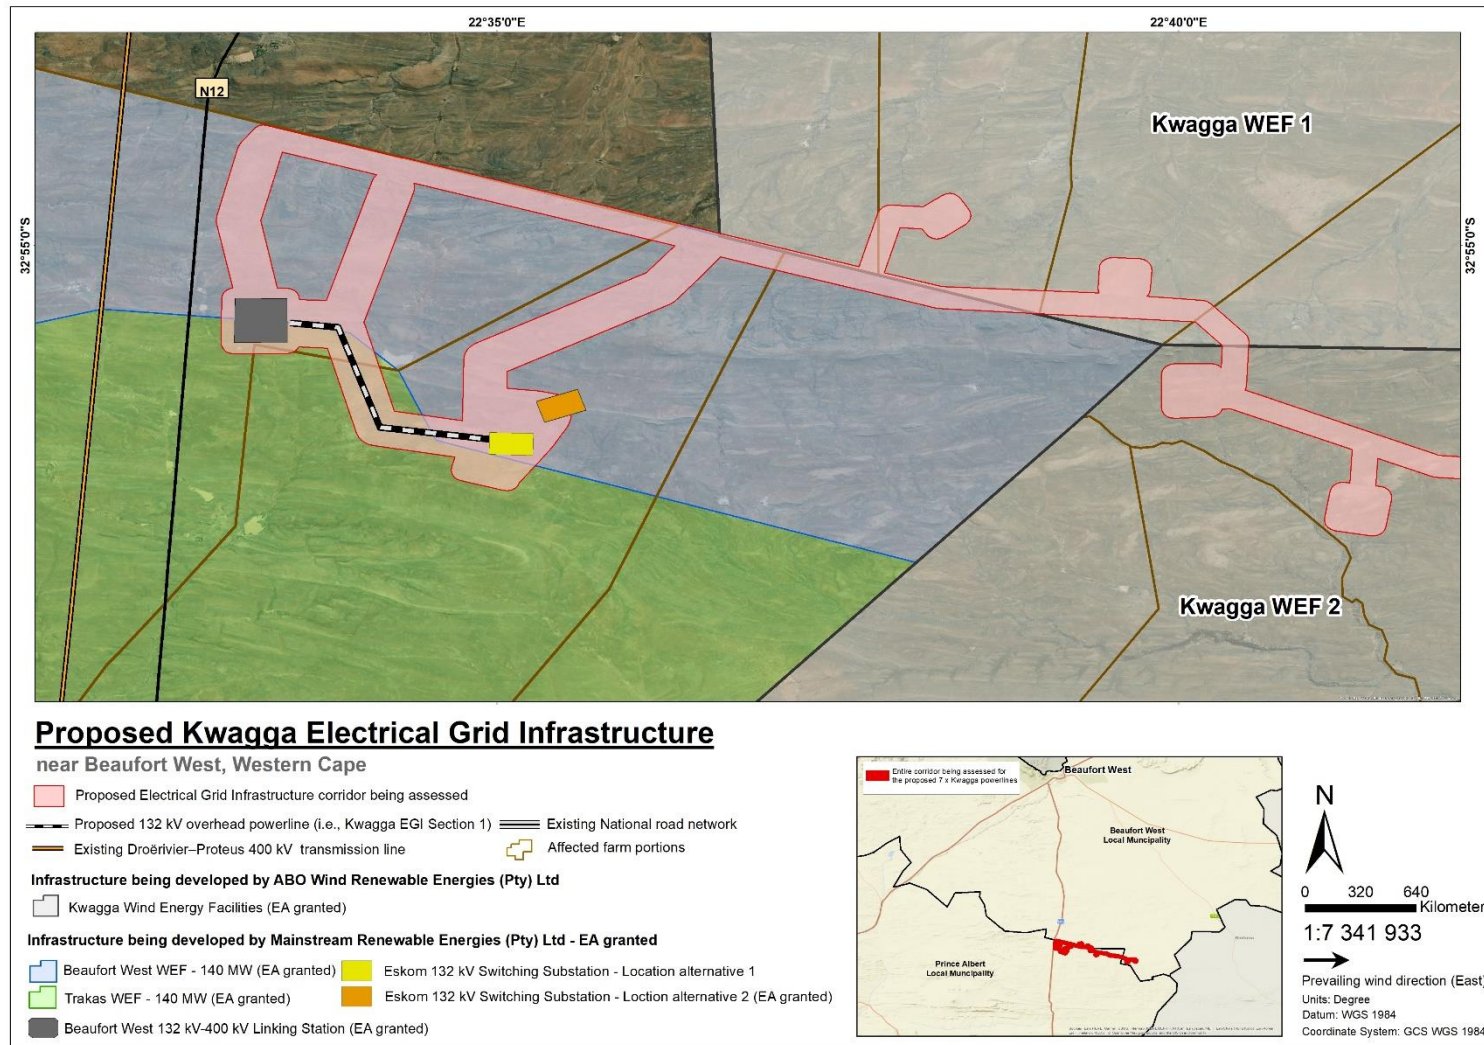


Figure C.2: The proposed Kwagga EGI Section 1 of the 132 kV overhead powerline corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation

FINAL BASIC ASSESSMENT REPORT: Basic Assessment for the proposed construction of a 132 kV Overhead Powerline between the proposed Beaufort West 132kV-400kV Linking Station and the proposed Eskom 132 kV Switching Substation, near Beaufort West in the Western Cape Province

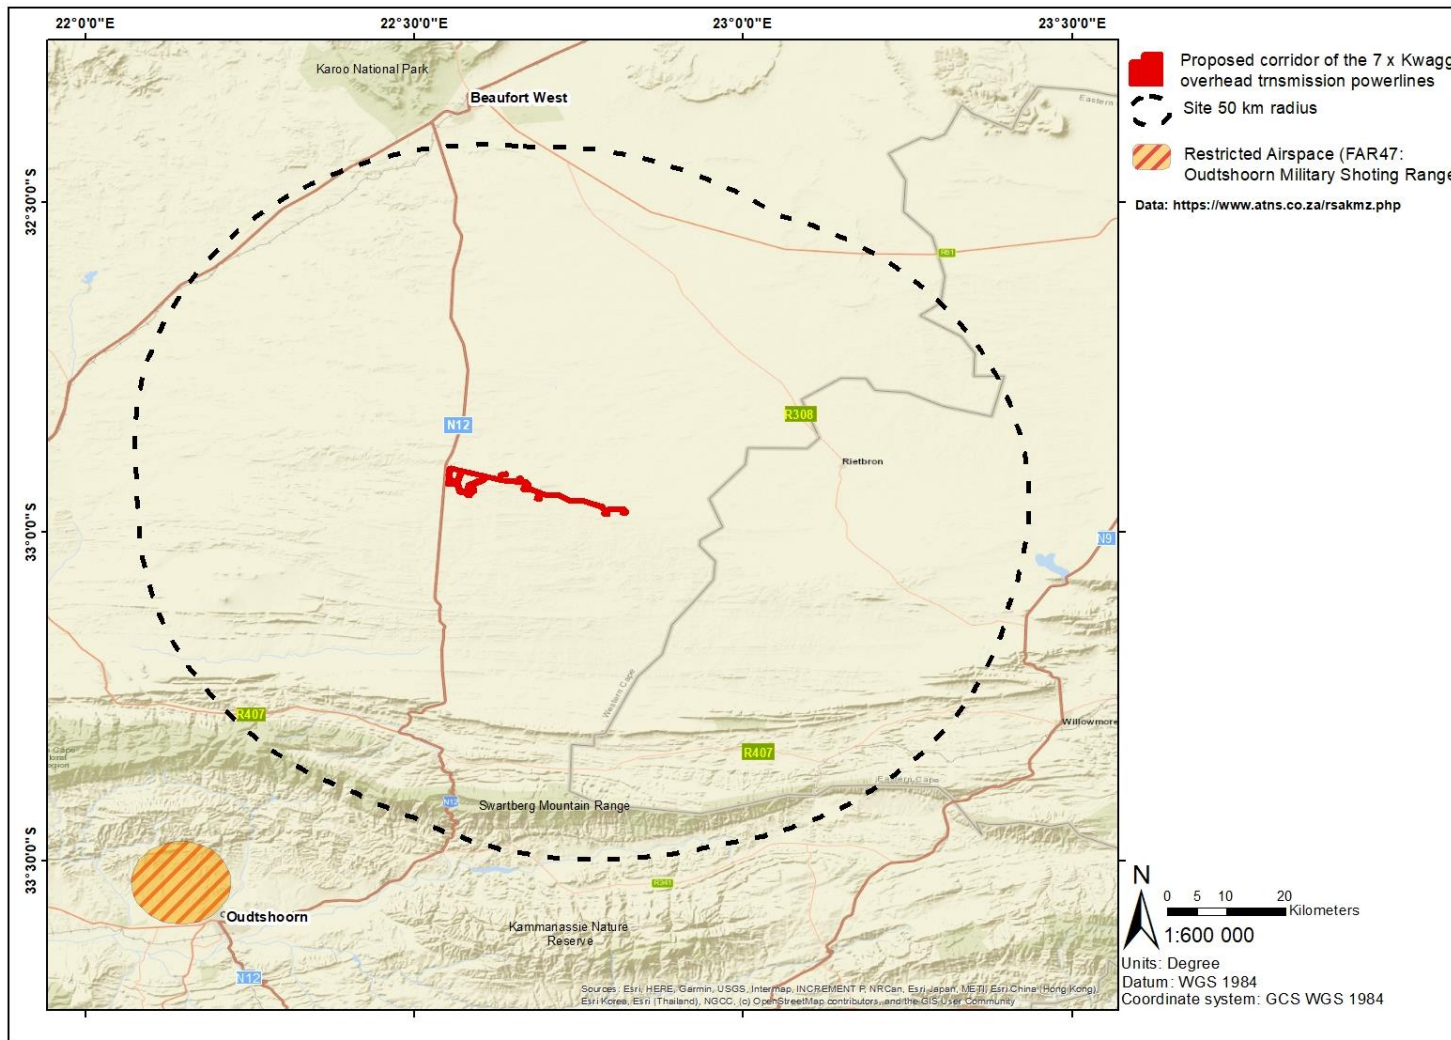


Figure C.4: Defence Features relative to the seven proposed 132 kV overhead transmission powerline projects site based on the Site Sensitivity Verification.

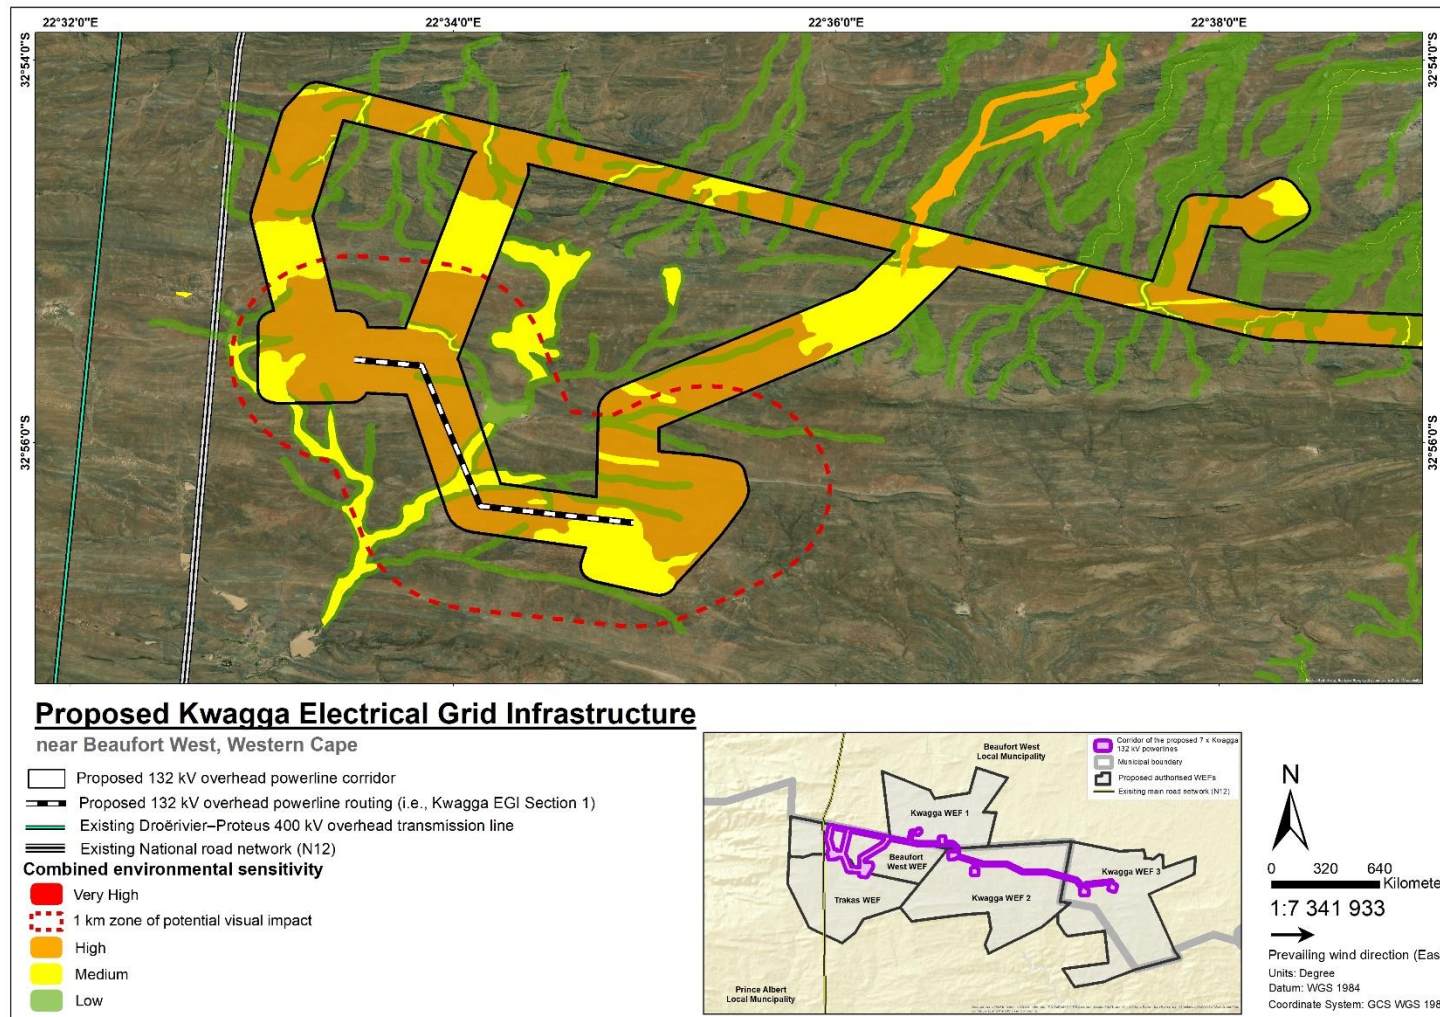


Figure C.5: Combined environmental sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation

FINAL BASIC ASSESSMENT REPORT: Basic Assessment for the proposed construction of a 132 kV Overhead Powerline between the proposed Beaufort West 132kV-400kV Linking Station and the proposed Eskom 132 kV Switching Substation, near Beaufort West in the Western Cape Province

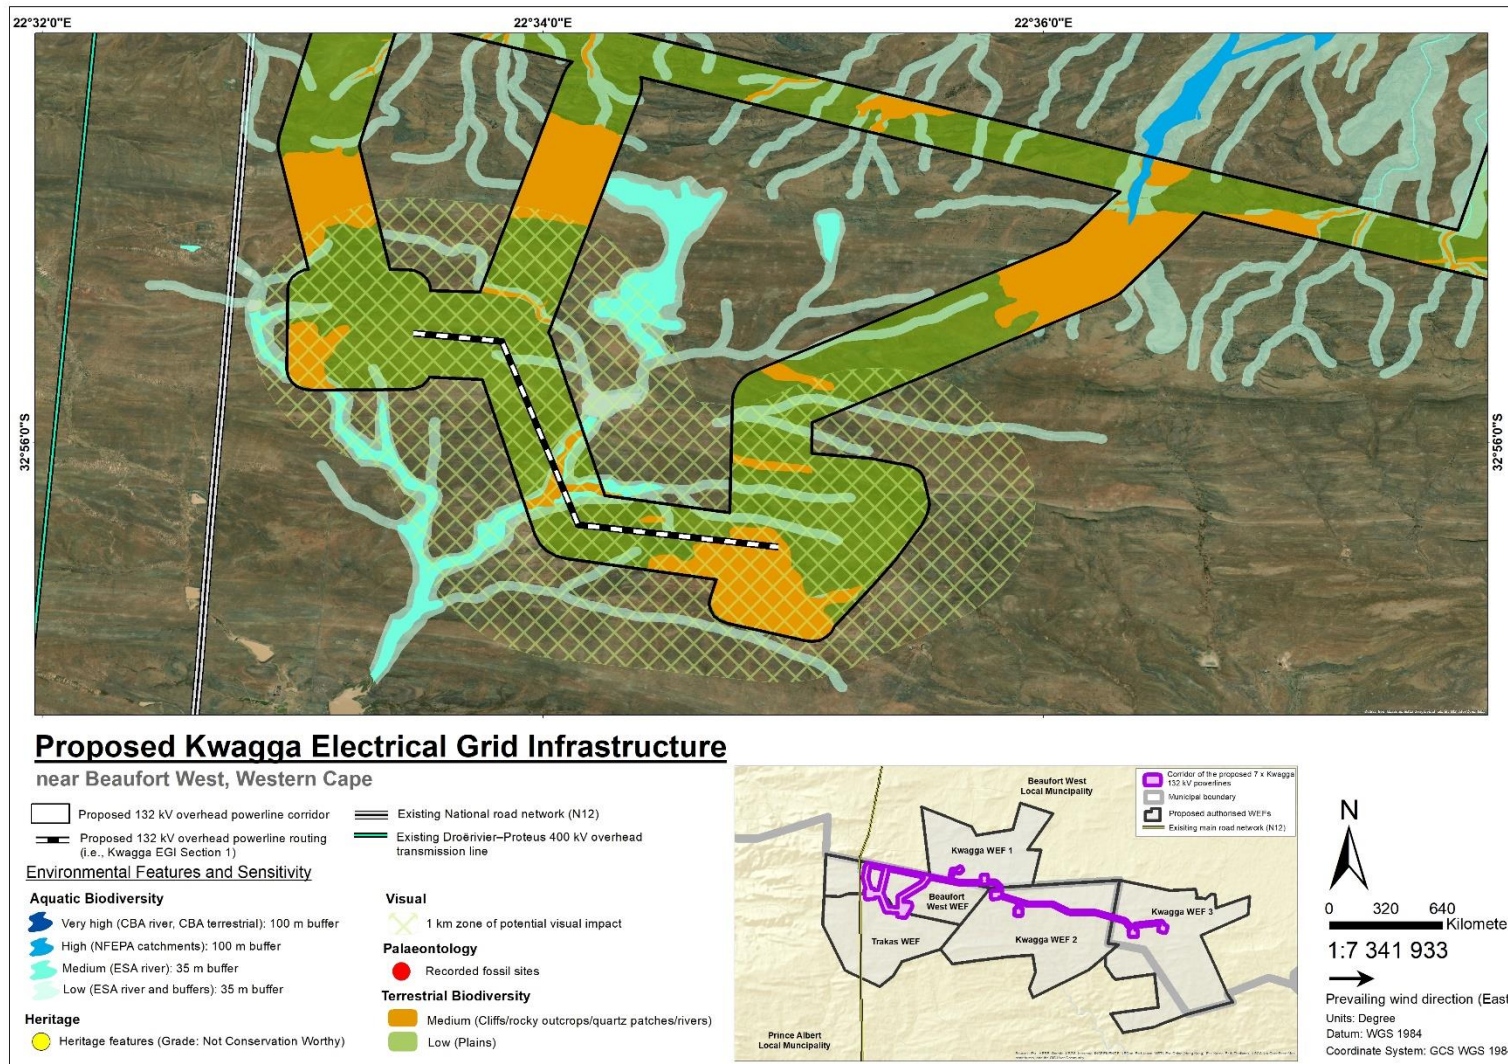


Figure C.6: Environmental features map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.

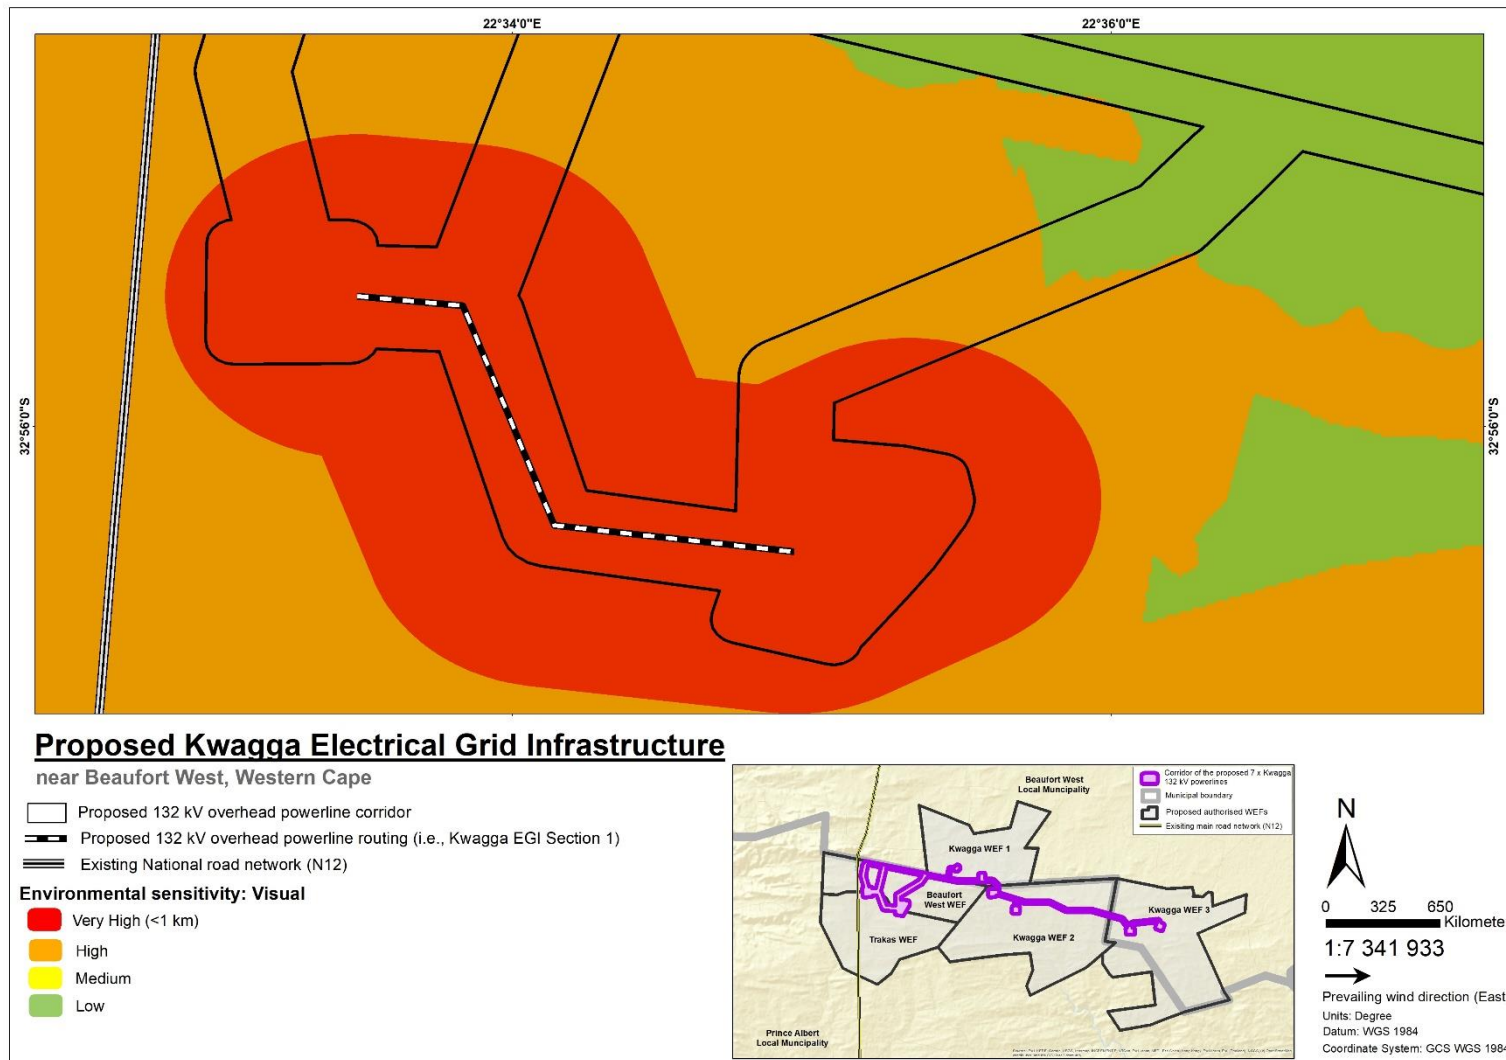


Figure C.7: Visual sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.

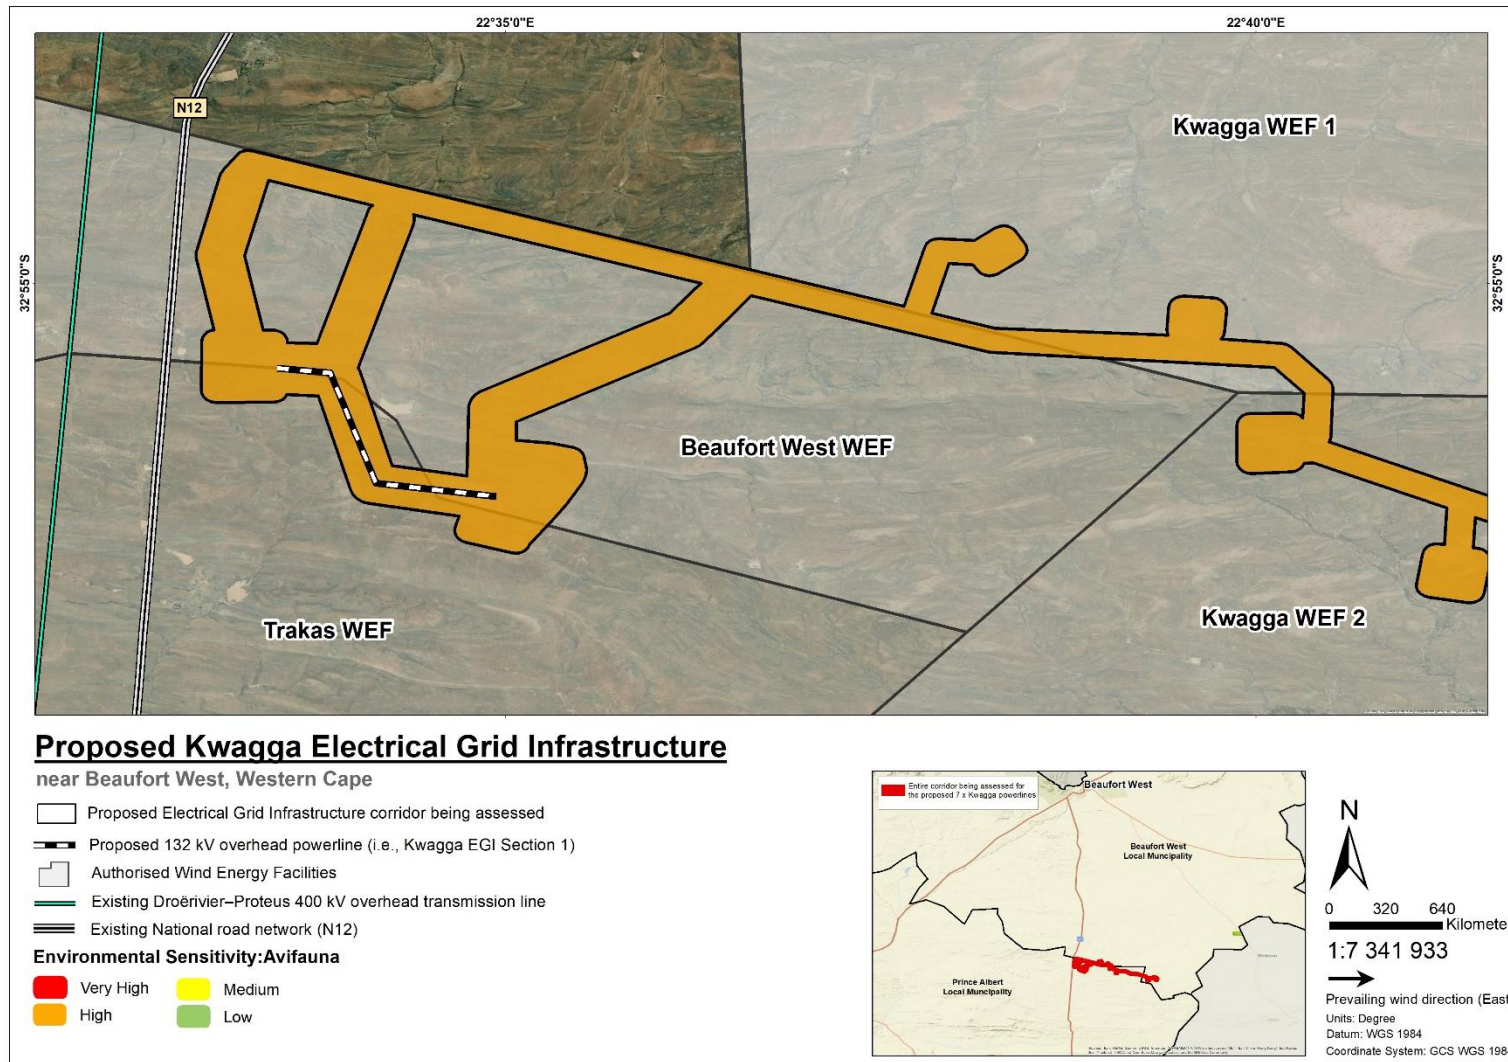


Figure C.8: Avifauna sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.

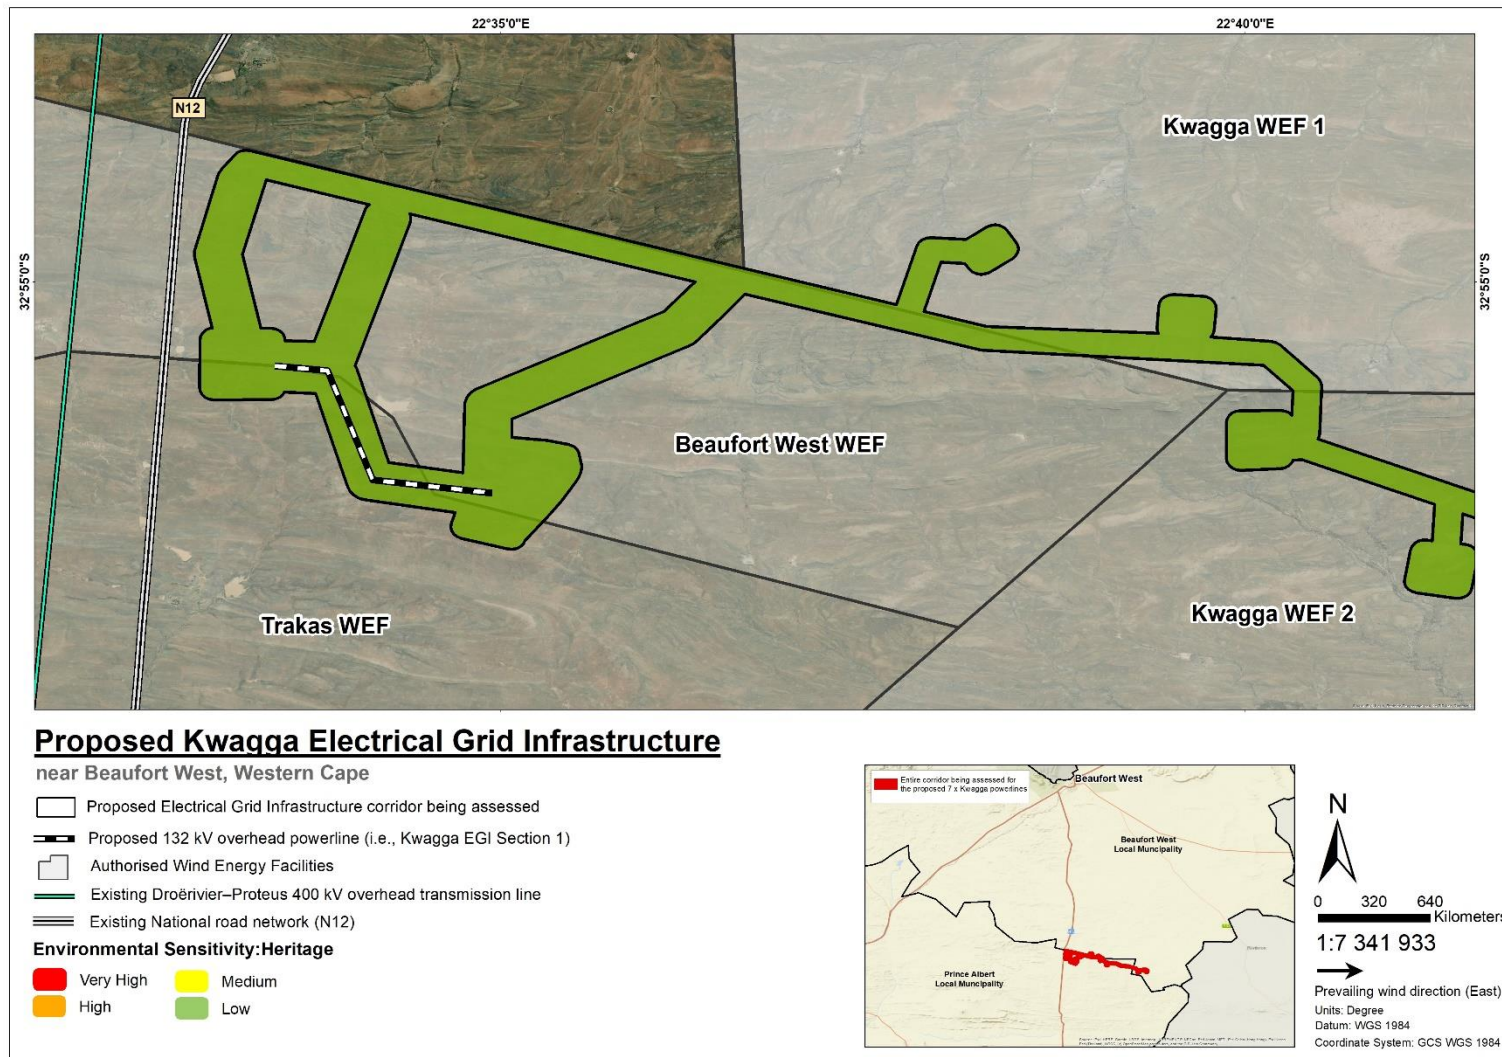


Figure C.9: Heritage sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.

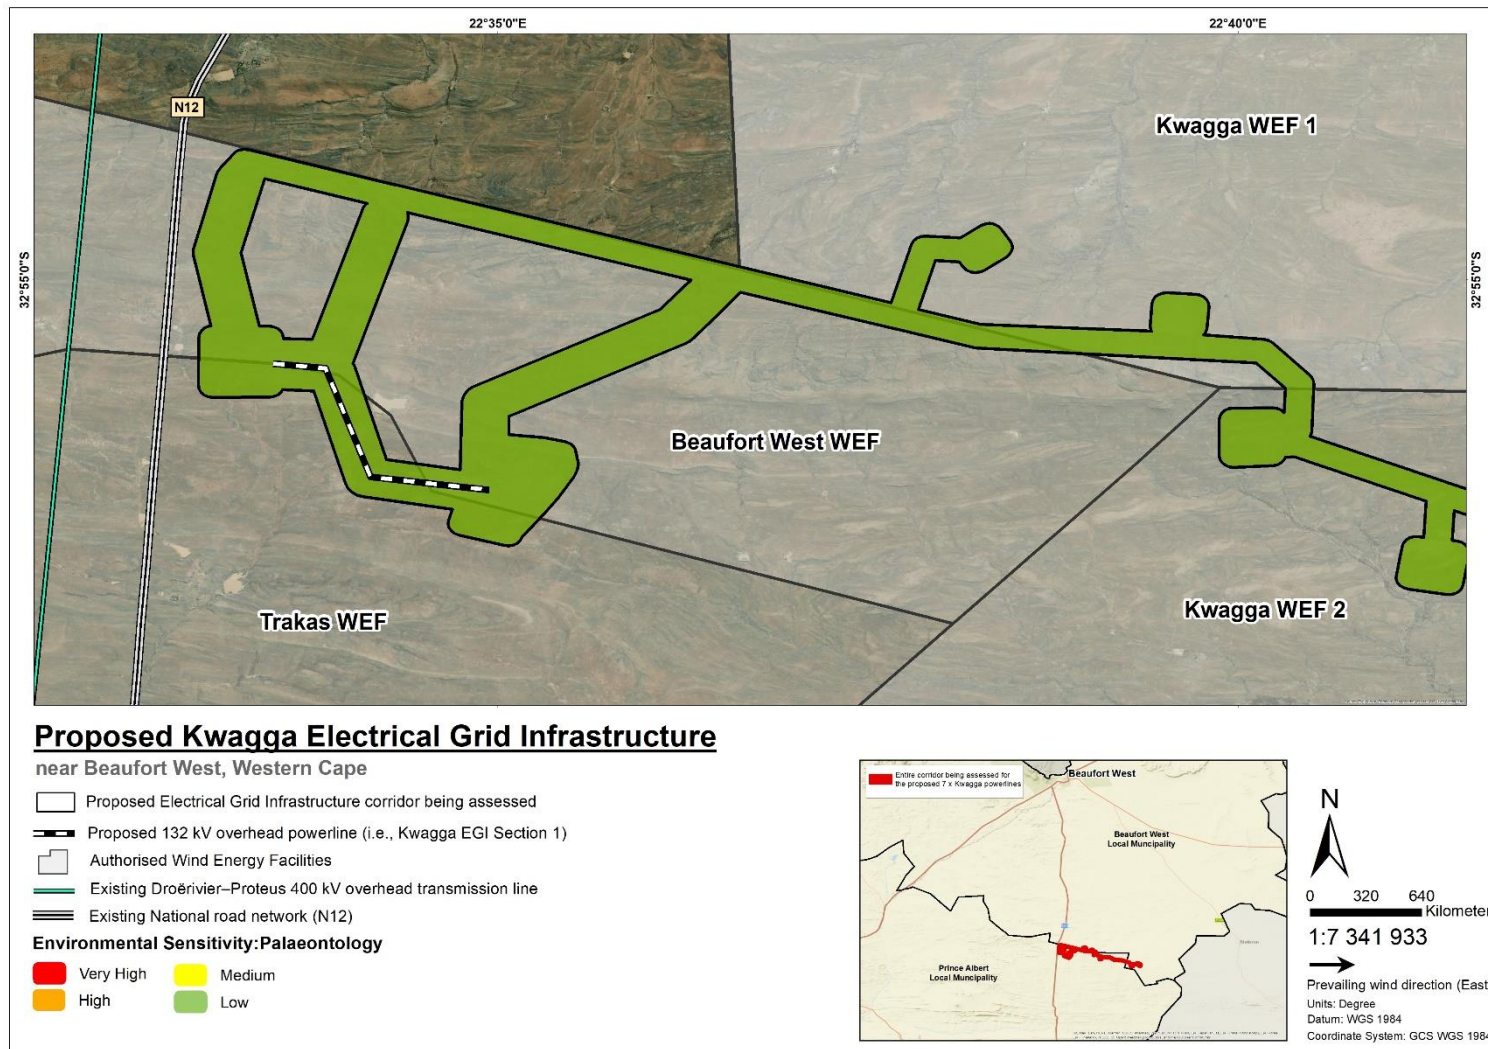


Figure C.10: Palaeontological sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.

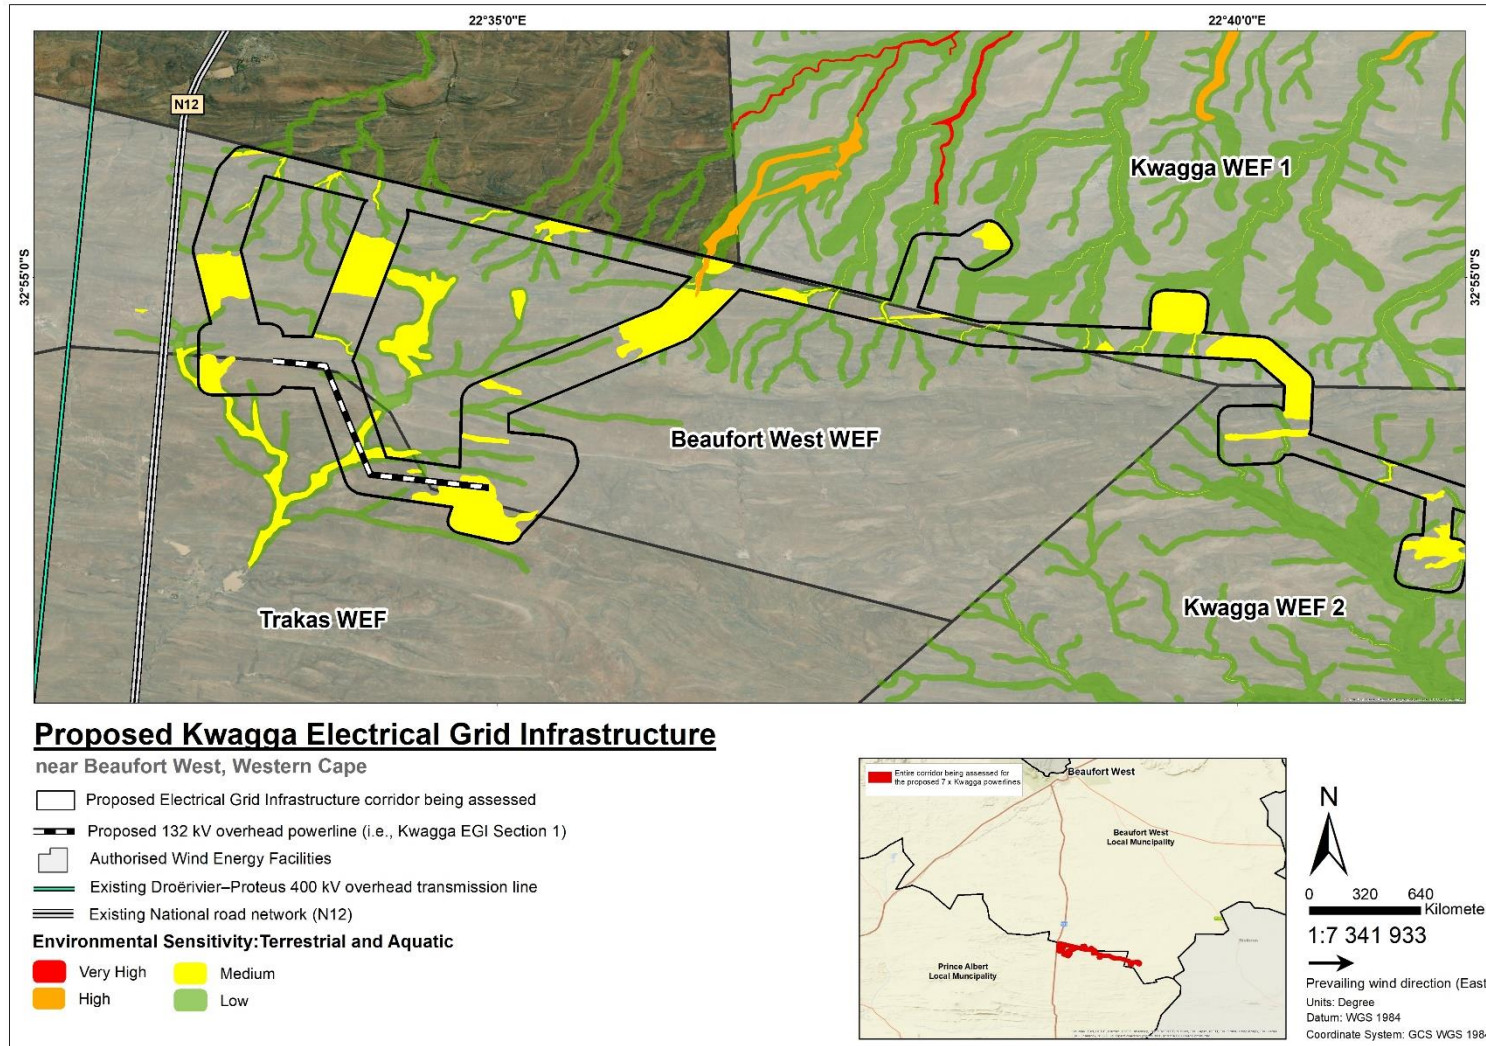


Figure C.11: Terrestrial Biodiversity and Aquatic sensitivity map for the proposed 132 kV overhead powerline i.e. Section 1 of the Kwagga EGI corridor, which extends between the proposed authorised Beaufort West 132 kV-400 kV Linking Station and the Eskom 132 kV Switching Substation.